



ABUS Security-Center GmbH & Co. KG  
Linker Kreuthweg 5 · 86444 Affing (Germany)  
www.abus.com



**AZSG10000 | AZSG10005 | AZSG10010**  
**ABUS Draht-Außensirene | ABUS Wired Outdoor Sounder**

**Sirenendauer**  
**Siren Timing**

[LK9] **Sound output**

[LK8] 3 Min  
[LK7] 15 Min  
[LK6] Intermittent


= Standard  
Default

**Leitungsüberwachung**  
**Trigger Wire Monitor**


[LK5] OFF ON  
[LK4]+ve -ve STROBE  
[LK3]+ve -ve TRIG/SIREN  
[LK2]+ve -ve TAMPER RTN

**Polarität/Polarity**

[LK1] **SCB**  
**SAB**

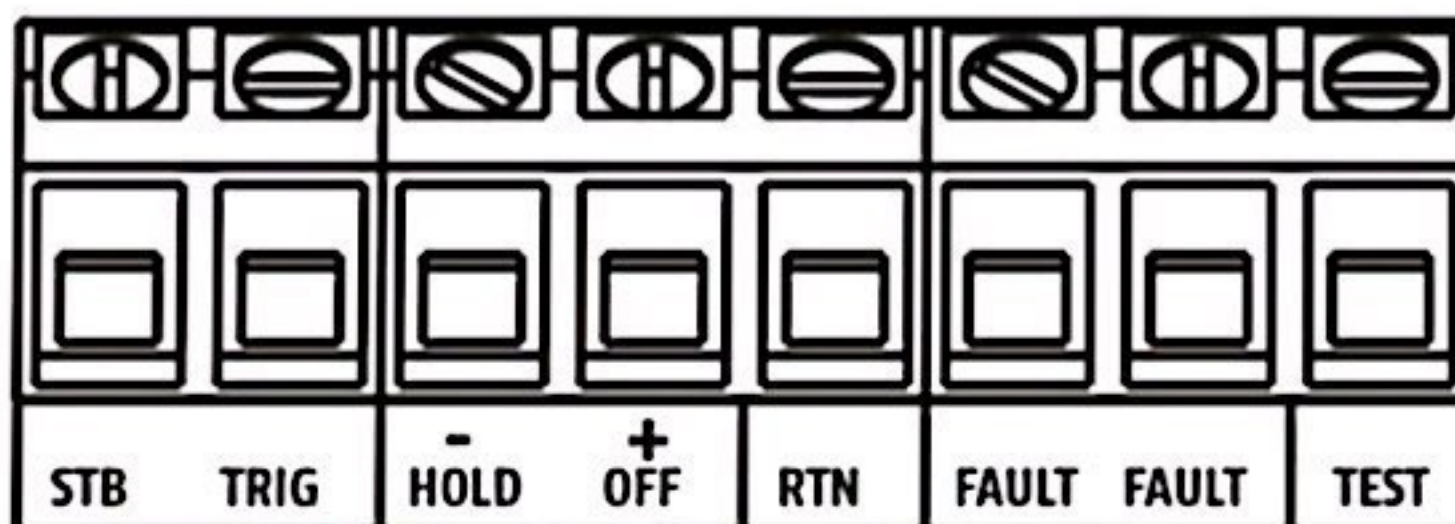

EN50131-4:2009. Type Z  
Security Grade 3  
Environmental Class IV  
Read Instructions before  
changing selections.

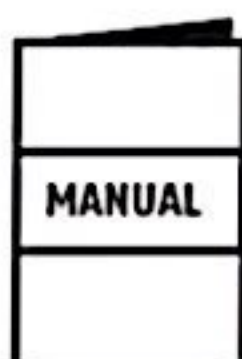

Datum/Date

**DANGER**

**HIGH VOLTAGE  
INSIDE COVER**

EXTREME CAUTION SHOULD BE  
EXERCISED WHEN POWER IS ON.  
WAIT 3 MINUTES AFTER STROBE HAS  
STOPPED BEFORE OPENING COVER